



2008/06/30 15.12


Dose rate HallD ceiling average for Standard Run

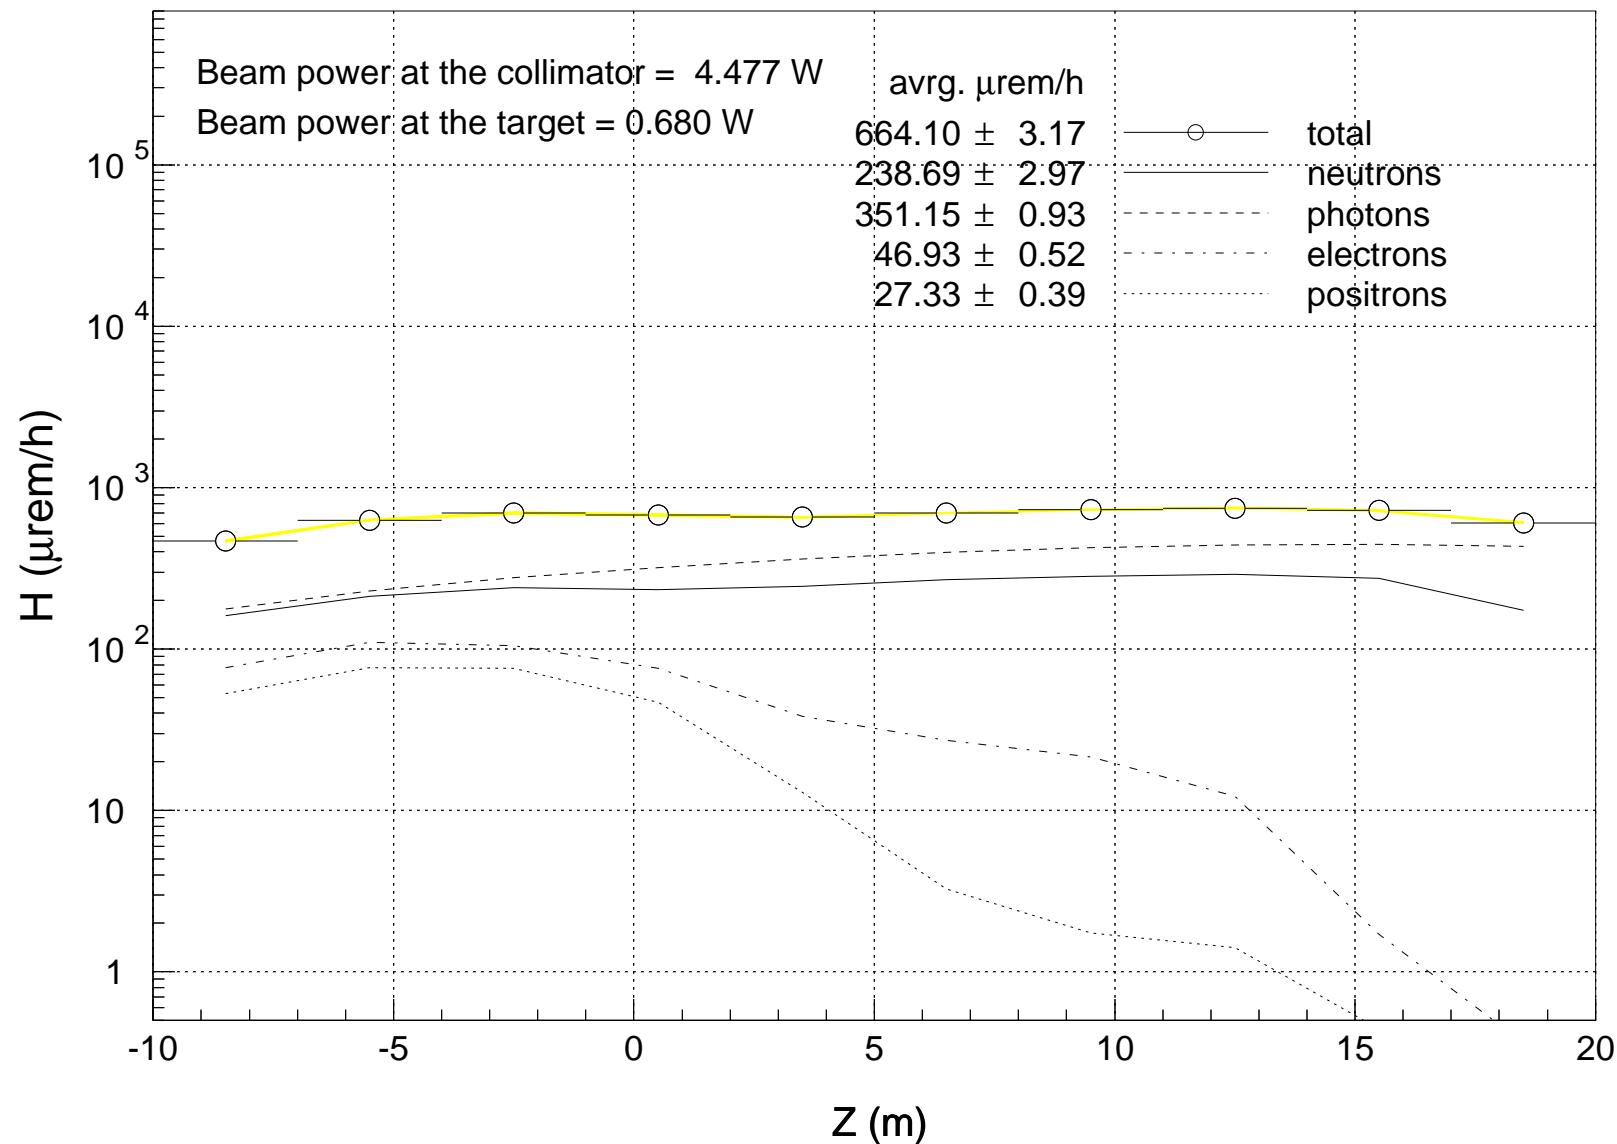


Dose rate HallD floor average for Standard Run

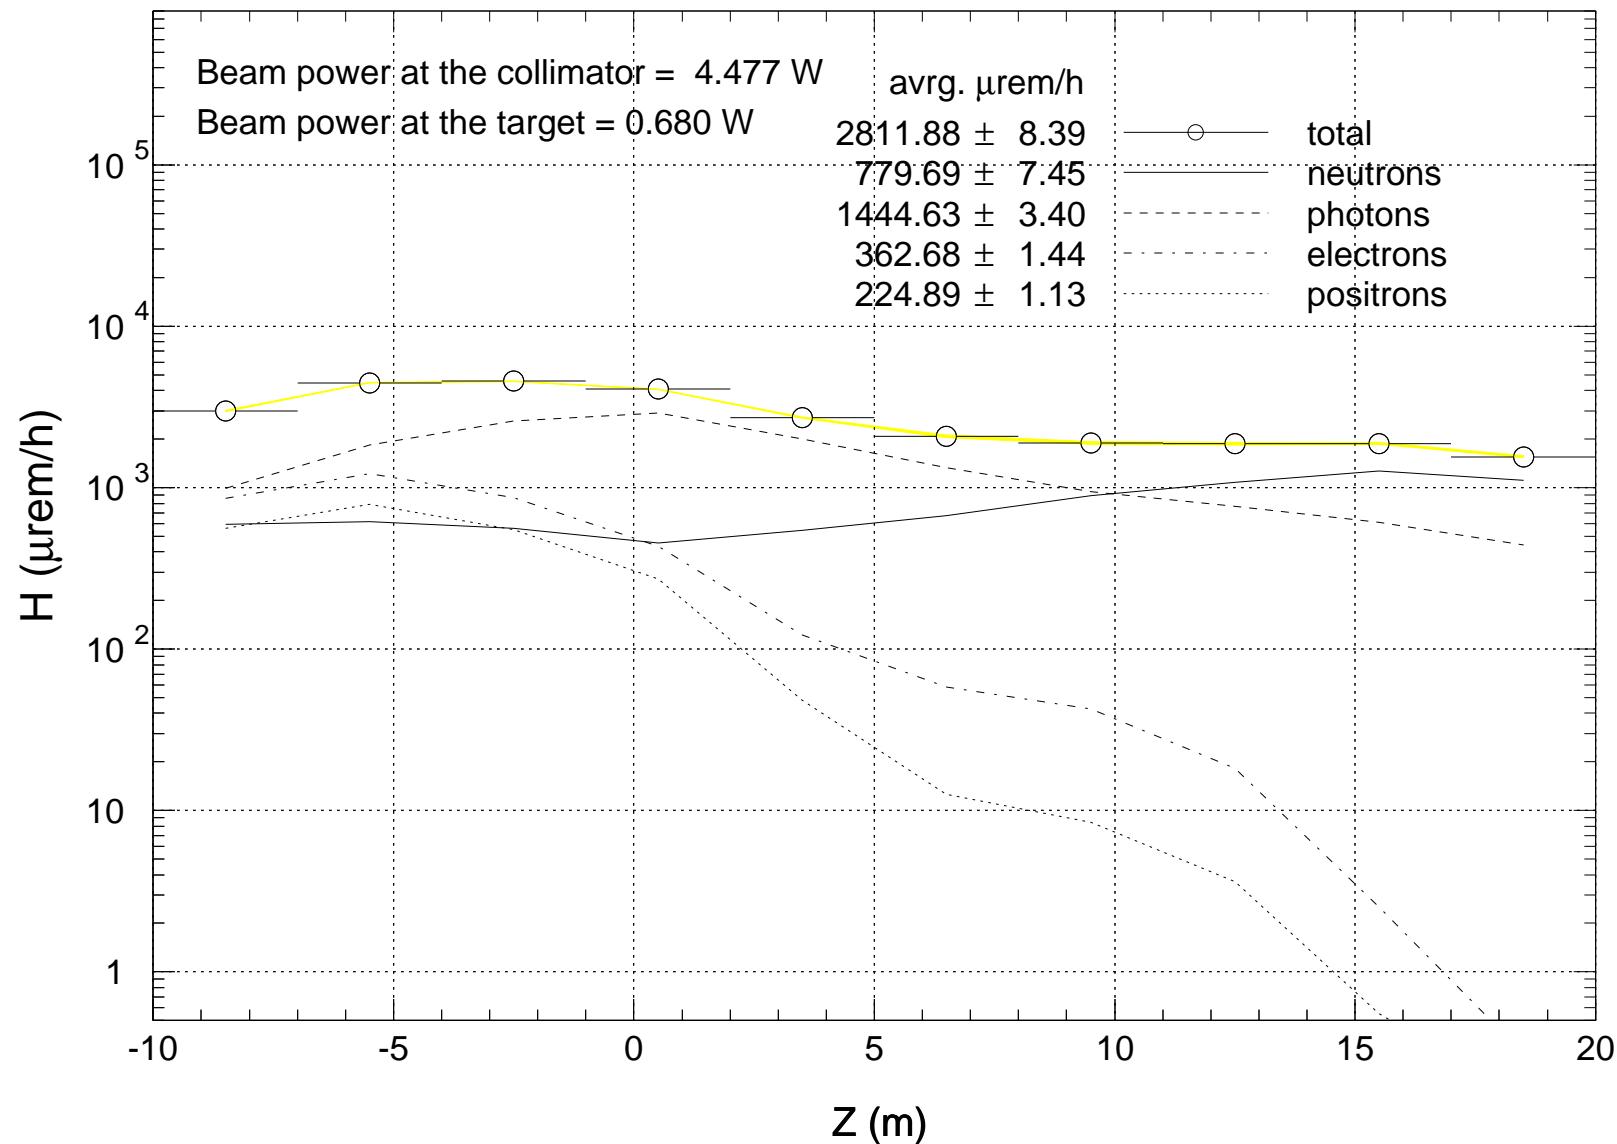

Dose rate HallD ceiling above the beamline for Standard Run

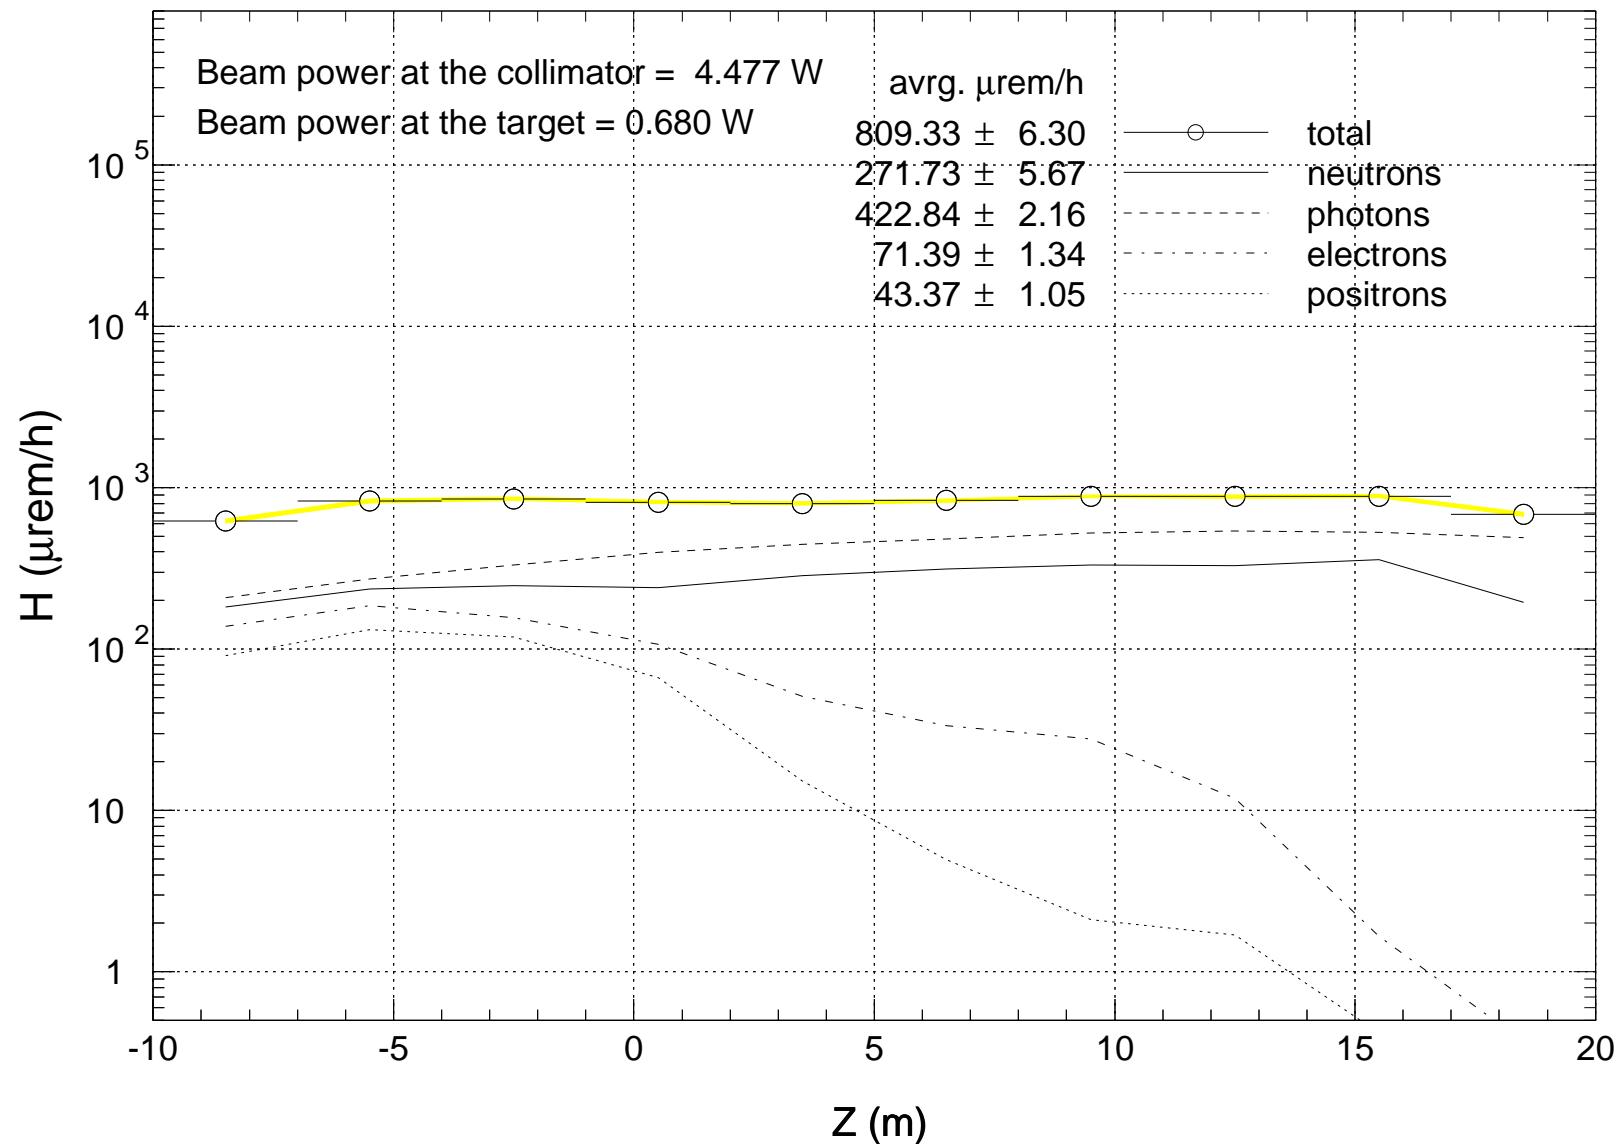

Dose rate HallD floor under the beamline for Standard Run

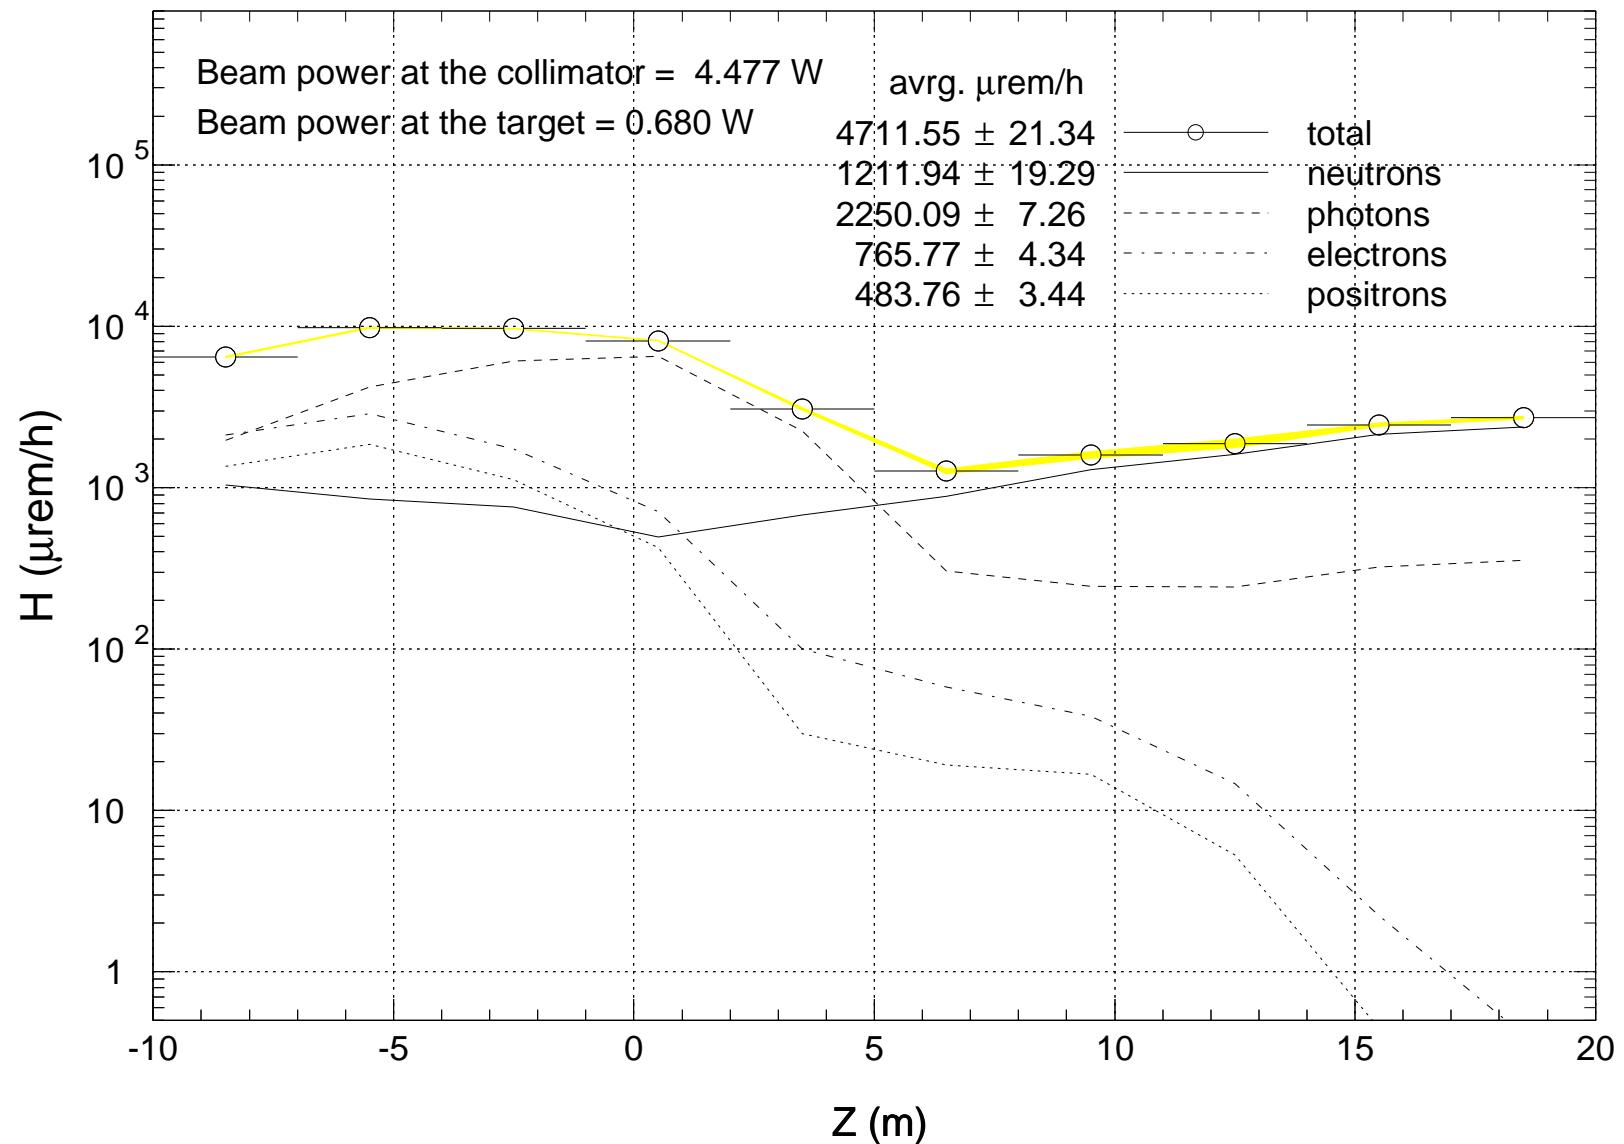

2008/06/30 15.12

Dose rate Collimator ceiling average for Standard Run

