



2009/05/26 10.38

Dose rate HallD ceiling average for Standard Run

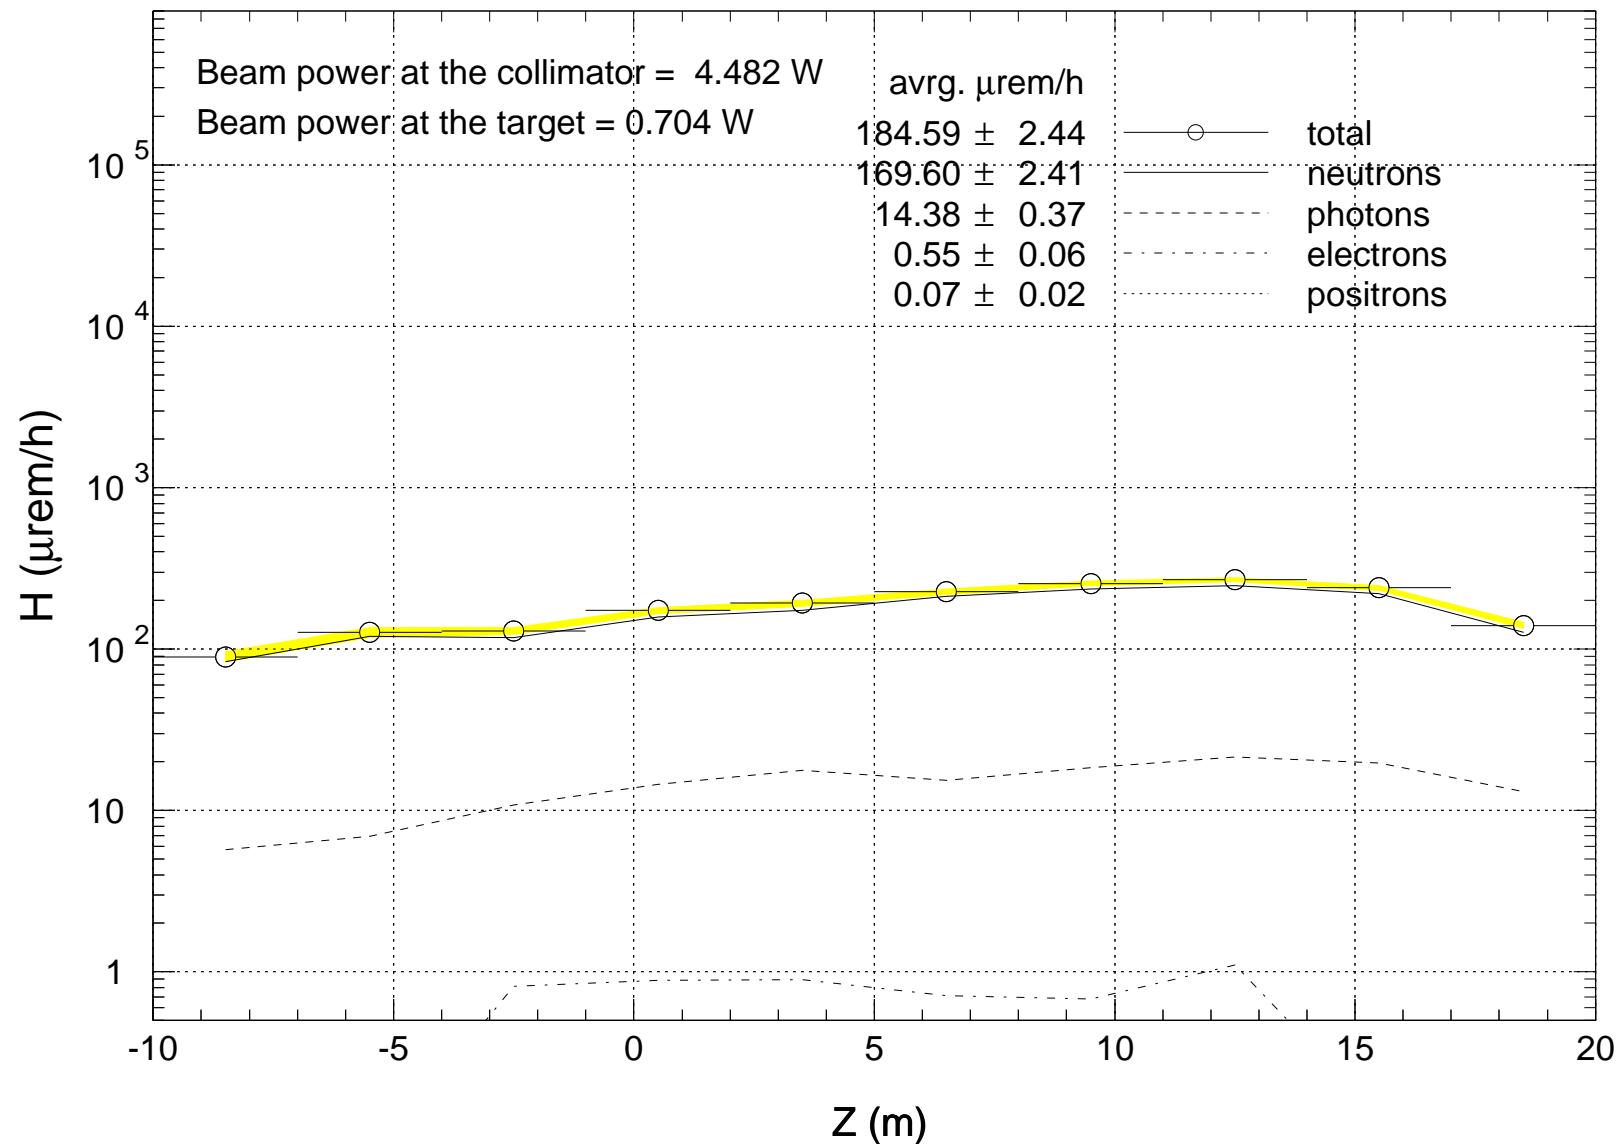


2009/05/26 10.38

Dose rate HallD floor average for Standard Run

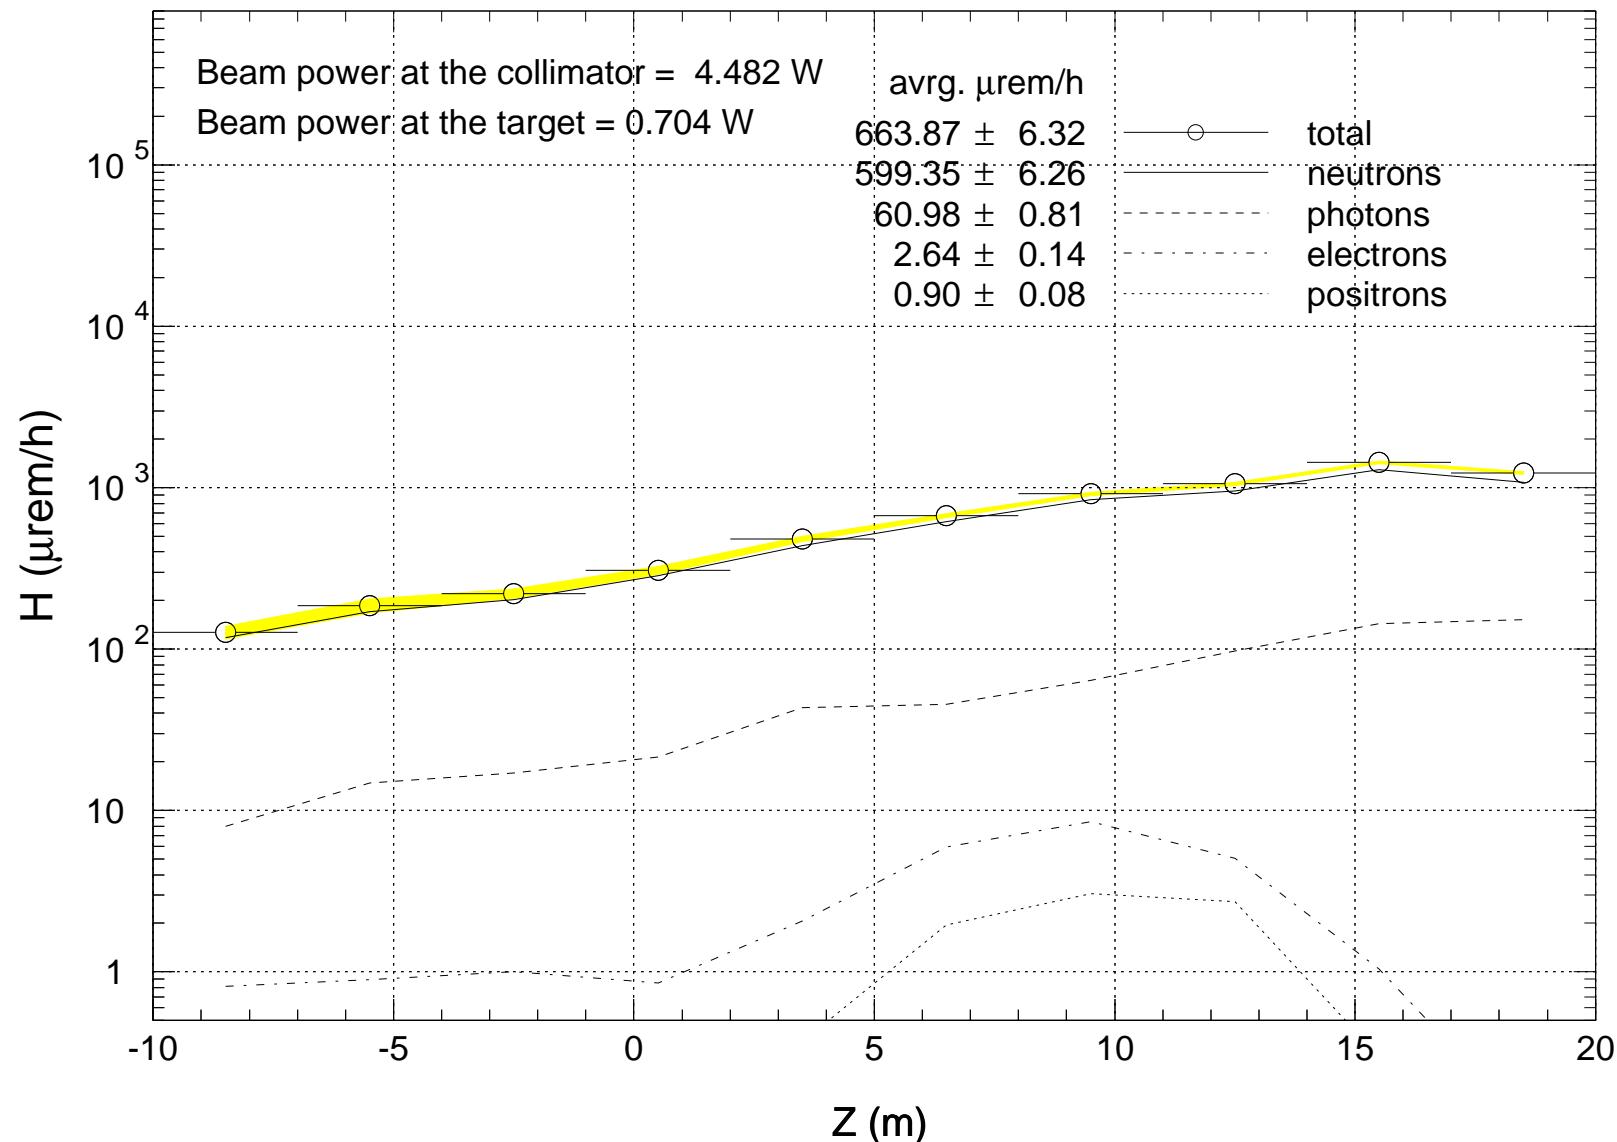


Dose rate HallID ceiling above the beamline for Standard Run

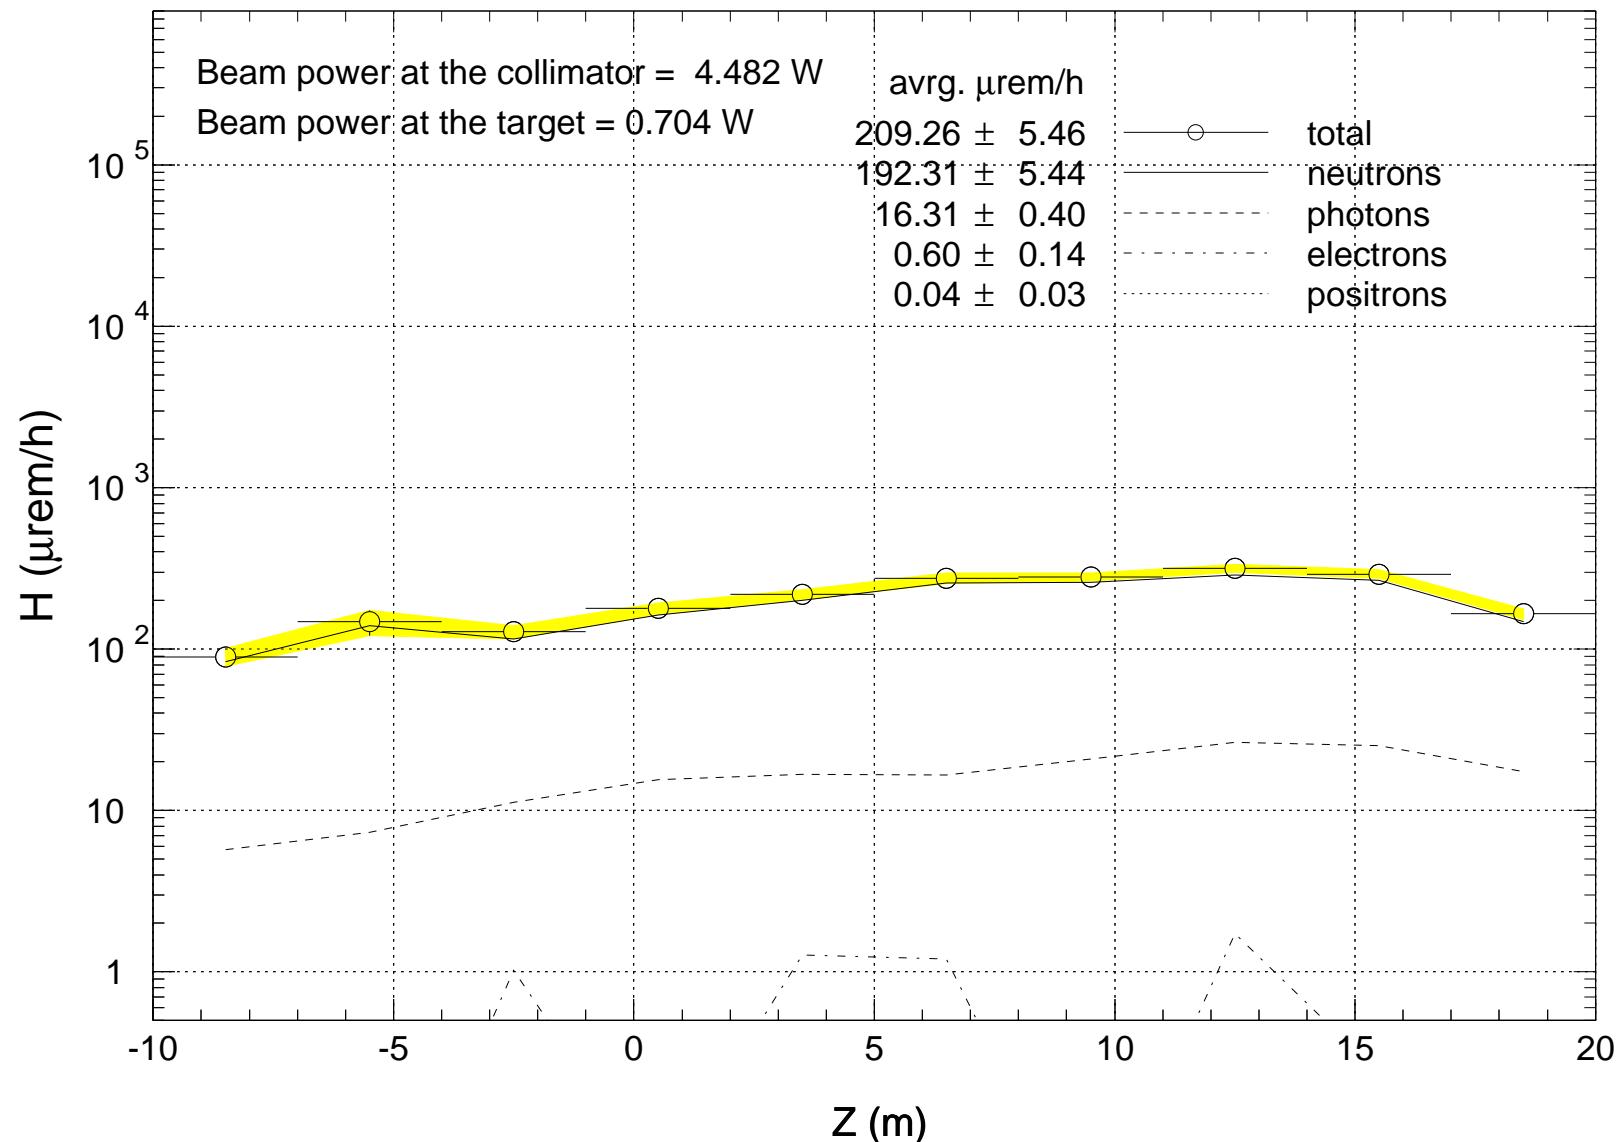

2009/05/26 10.38

Dose rate HallD floor under the beamline for Standard Run

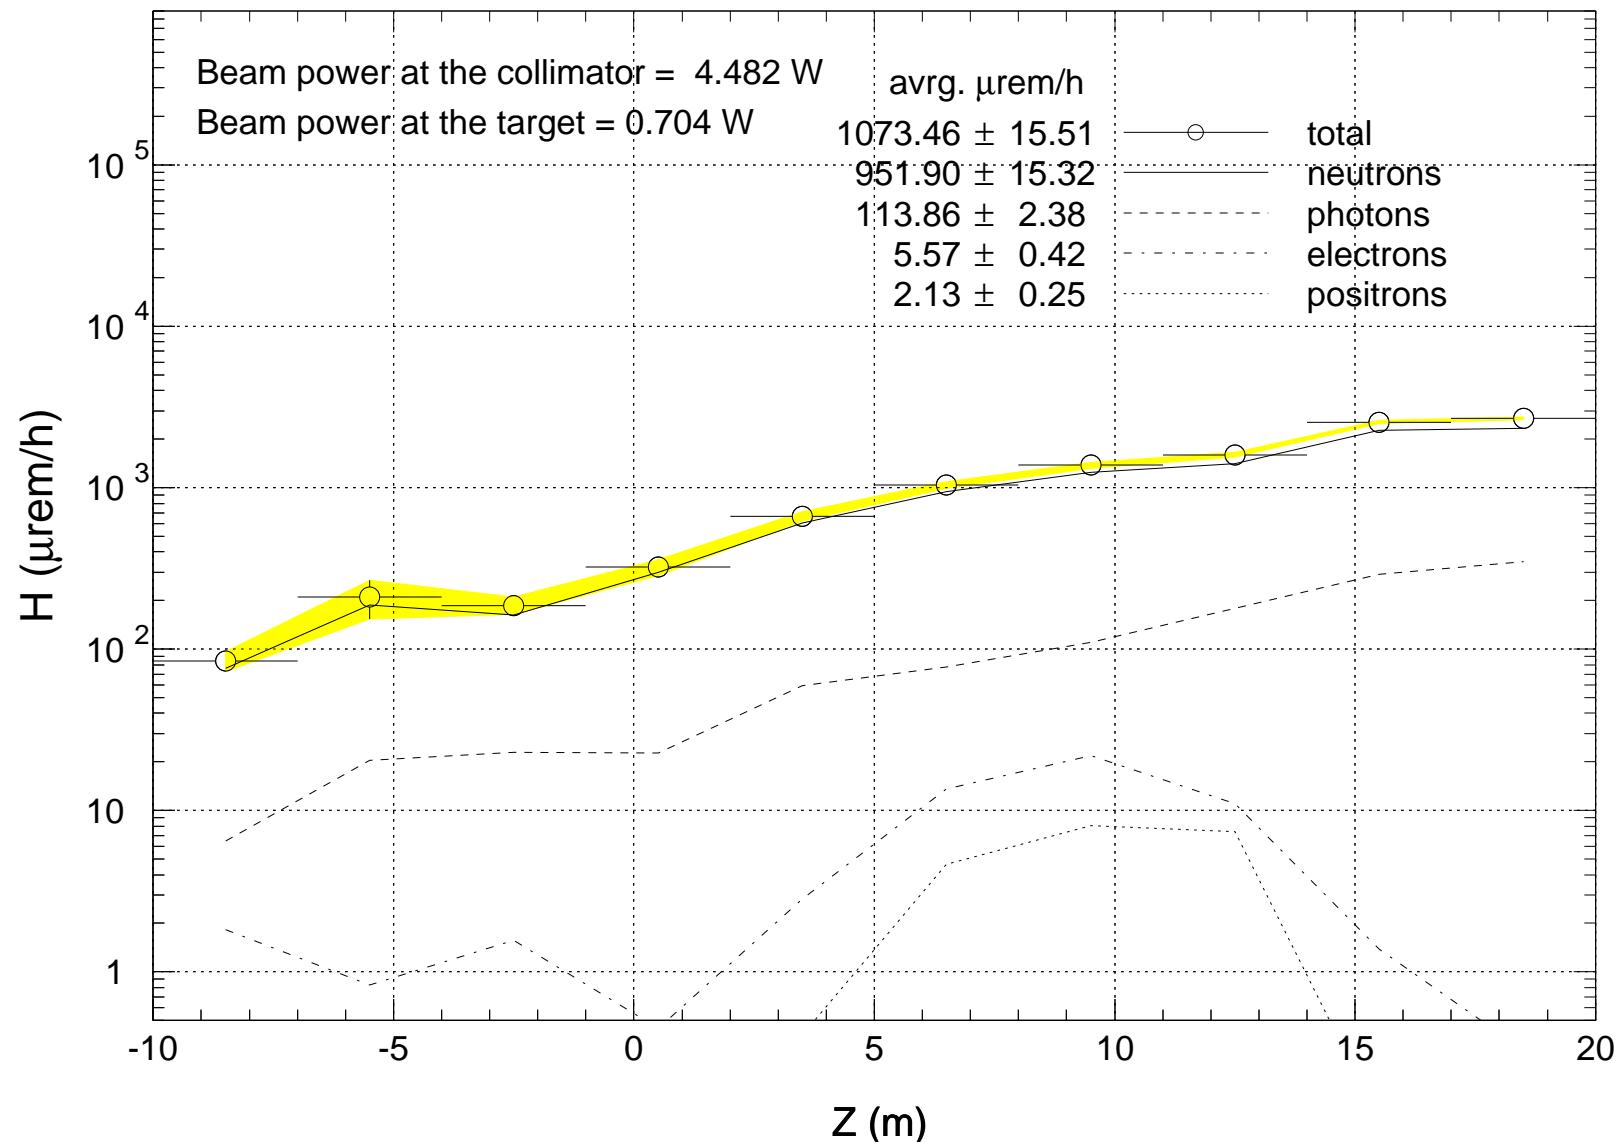

2009/05/26 10.38

Dose rate Collimator ceiling average for Standard Run

